

ITEM	DESCRIPTION				QTY.
1A	TRANSFORMER POWER RATING	TRANSFORMER VOLTAGE	PRI.	SEC.	1
1B	TRANSFORMER POWER RATING	TRANSFORMER VOLTAGE	PRI.	SEC.	1
2A	LINE ISOLATION MONITOR: MICROPROCESSOR, VOLT TOTAL HAZARD INDEX TO BE (5) mA, 15 MICROAMPS LEAKAGE CURRENT, NON-SWITCHING 2 CHANNEL CIRCUITRY, AND ALARM FOR LOSS OF GROUND CONNECTION TO L.I.M. U.L. APPROVED TYPE COMPLETE WITH DIGITAL HAZARD CURRENT METER, GREEN AND RED INDICATOR LIGHTS, SILENCE AND TEST SWITCHES, BUZZER AND FUSES.				1
2B	LINE ISOLATION MONITOR: MICROPROCESSOR, VOLT TOTAL HAZARD INDEX TO BE (5) mA, 15 MICROAMPS LEAKAGE CURRENT, NON-SWITCHING 2 CHANNEL CIRCUITRY, AND ALARM FOR LOSS OF GROUND CONNECTION TO L.I.M. U.L. APPROVED TYPE COMPLETE WITH DIGITAL HAZARD CURRENT METER, GREEN AND RED INDICATOR LIGHTS, SILENCE AND TEST SWITCHES, BUZZER AND FUSES.				1
3A	KVA	V BRANCH CIRCUIT BREAKERS CONSISTING OF:	20A	2-POLE	
		BOLT-ON, **16 CIRCUIT MAX.	30A	2-POLE	
			50A	2-POLE	
3B	KVA	V BRANCH CIRCUIT BREAKERS CONSISTING OF:	20A	2-POLE	
		BOLT-ON, **16 CIRCUIT MAX.	30A	2-POLE	
			50A	2-POLE	
4A	PRIMARY MAIN CIRCUIT BREAKER	VOLTS	AMPS, 2 POLE		1
4B	PRIMARY MAIN CIRCUIT BREAKER	VOLTS	AMPS, 2 POLE		1
5	GROUND BUS-24 BRANCH CIRCUITS, SIZE #14 TO #6				2
6A	LEFT SIDE WIRING COMPARTMENT, NORMAL POWER				1
6B	RIGHT SIDE WIRING COMPARTMENT, EMERGENCY POWER				1
7	REMOTE ANNUNCIATOR TERMINAL BLOCKS				2
8	FRONT PANEL, 477-221-304				1
9	BACKBOX, 200-650-176				1

TOTAL REQUIRED

GENERAL NOTES:

- BOX WILL BE CONSTRUCTED OF GALVANIZED STEEL, IN ACCORDANCE WITH U.L. STANDARD 50.
- BOLT-IN CHASSIS FASTENS TO STUDS IN BACK OF BOX.
- FRONT WILL BE FABRICATED OF 12GA., TYPE 304 STAINLESS STEEL AND FINISHED WITH A #4 SATIN POLISH.
- CONDUIT ENTRANCE AREA IS DESIGNED ON LAYOUT FOR GROUNDED POWER ONLY. BRANCH CIRCUITS AND SIGNAL CONDUITS MAY ENTER ANY OTHER AREA OF BOX.
- BRANCH CIRCUIT WIRING TO BE #12 XHHW.
- ANNUNCIATOR WIRES TO BE 18 THHN OR EQUAL.

REFERENCE:

FOR:

FOR REFERENCE ONLY

STD. B.O.M.: DIDP04002.xls ACAD STD.: DIDP04002.dwg




POST GLOVER LIFELINK
 4750 OLYMPIC BLVD. BLDG. B
 ERLANGER, KY U.S.A. 41018 (859) 283-5900
 COPYRIGHT © 2004

THIS DOCUMENT AND THE INFORMATION IT CONTAINS ARE THE PROPERTY OF POST GLOVER LIFELINK. IT IS DISCLOSED FOR THE PURPOSE FOR WHICH IT IS FURNISHED AND SHALL NOT BE DUPLICATED OR DISTRIBUTED.

TITLE/DESCRIPTION:
 3-10KVA DUPLEX ISOLATED DISTRIBUTION PANEL, SINGLE PHASE, FLUSH MOUNT
 TYPE: DIDP (VENTED)

DFTR: JJM DATE: 03/23/04 DWG. NO.: REV.: 01

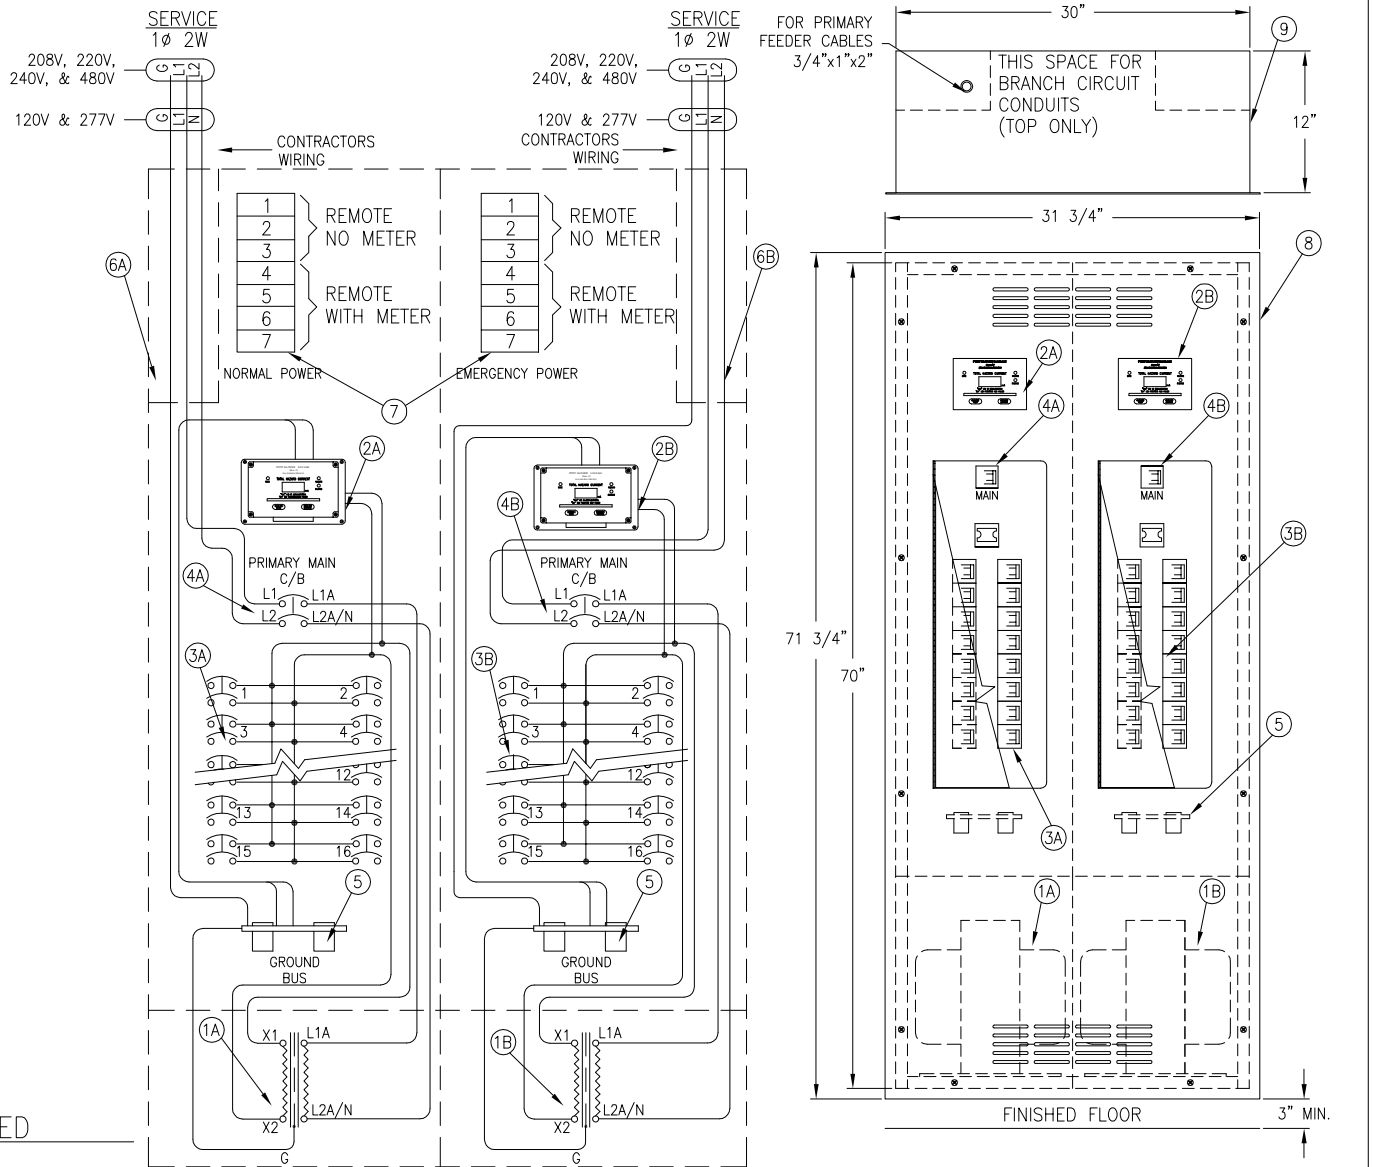

ECN# 04-016. UPDATED DRAWING
JJM 05/03/04/01
REVISIONS

S.O. NUM.: