


BILL OF MATERIALS		
ITEM #	QTY.	DESCRIPTION
1	1	TYPE 304 S.S. FACE PLATE
2	6	GROUND JACK RECEPTACLE, 30 AMP
3	1	GROUND BUS FOR WIRE #14 - #6
4	1	MAIN LUG FOR WIRE #14 - 1/0

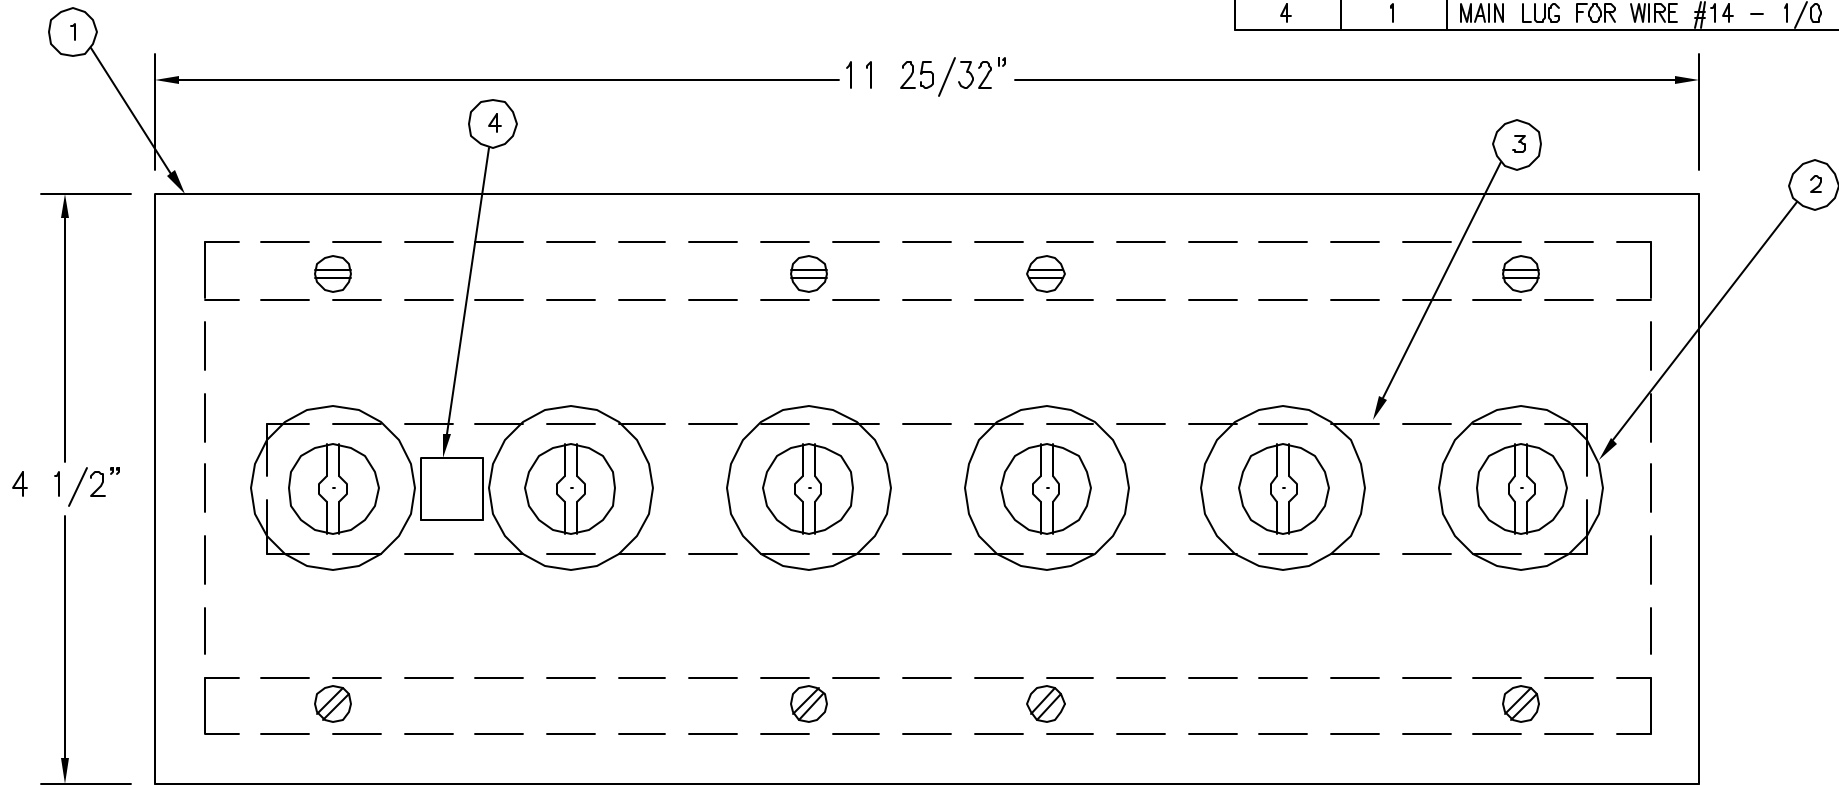

TOTAL REQUIRED _____

NOTES:
 1). STANDARD SWITCH BOX OR EQUIVALENT MASONRY BOX FURNISHED BY OTHERS. MINIMUM OF 2 3/4" DEPTH.

UPDATED LAYOUT BORDER	JAP 10/14/04 01
REVISIONS	

FOR: **FOR REFERENCE ONLY**

S.O. NUM.:

STD. B.O.M.: GJP-6-6G.xls ACAD STD.: 66G.dwg

TITLE/DESCRIPTION:
 GROUND JACK PANEL
 TYPE: GJP-6-6G



POST GLOVER LIFELINK
 4750 OLYMPIC BLVD. BLDG. B
 ERLANGER, KY U.S.A. 41018 (859) 283-5900
 COPYRIGHT © 2004

DFTR: EEU DATE: 04/22/98 DWG. NO.: **66G** REV.: 01

THIS DOCUMENT AND THE INFORMATION IT CONTAINS ARE THE PROPERTY OF POST GLOVER LIFELINK. IT IS UNCLASSIFIED FOR THE PURPOSE FOR WHICH IT IS FURNISHED AND SHALL NOT BE DUPLICATED OR DISTRIBUTED.